


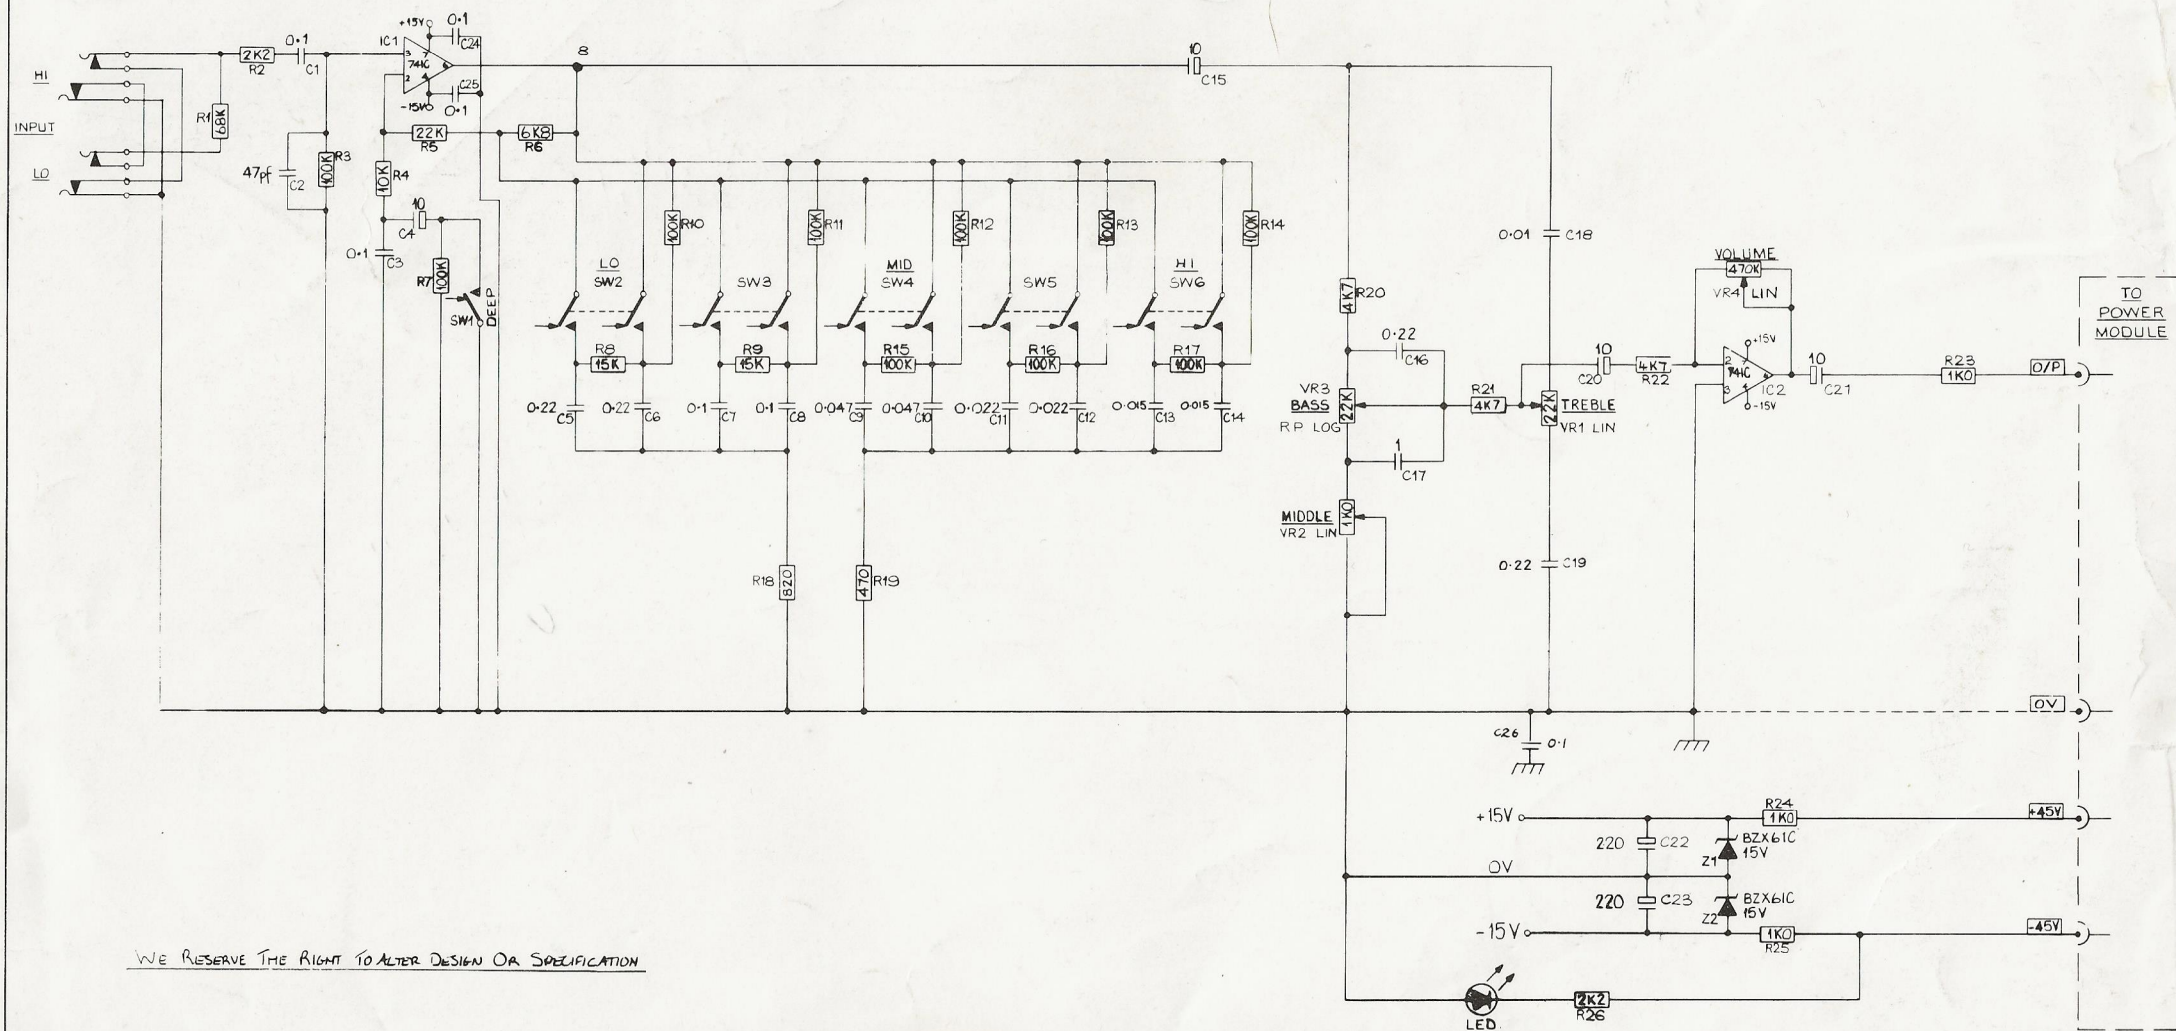

ISSUE 3	ISSUE 2	ISSUE 1
	CR6, 0.1µF ADDED	R22 was 10K VR4 was Log
	HL	N.B.
	11.1.78	1.7.77


**CARLSBRO
SOUND
EQUIPMENT**

DRAWN J. ELLIOTT	DATE 8-12-76
CHECKED J. Daniels	SCALE N.T.S.
FILE	TOLERANCES

MATERIAL	FINISH

TITLE
CIRCUIT DIAGRAM
BASS AMP

DRG. N°
10247

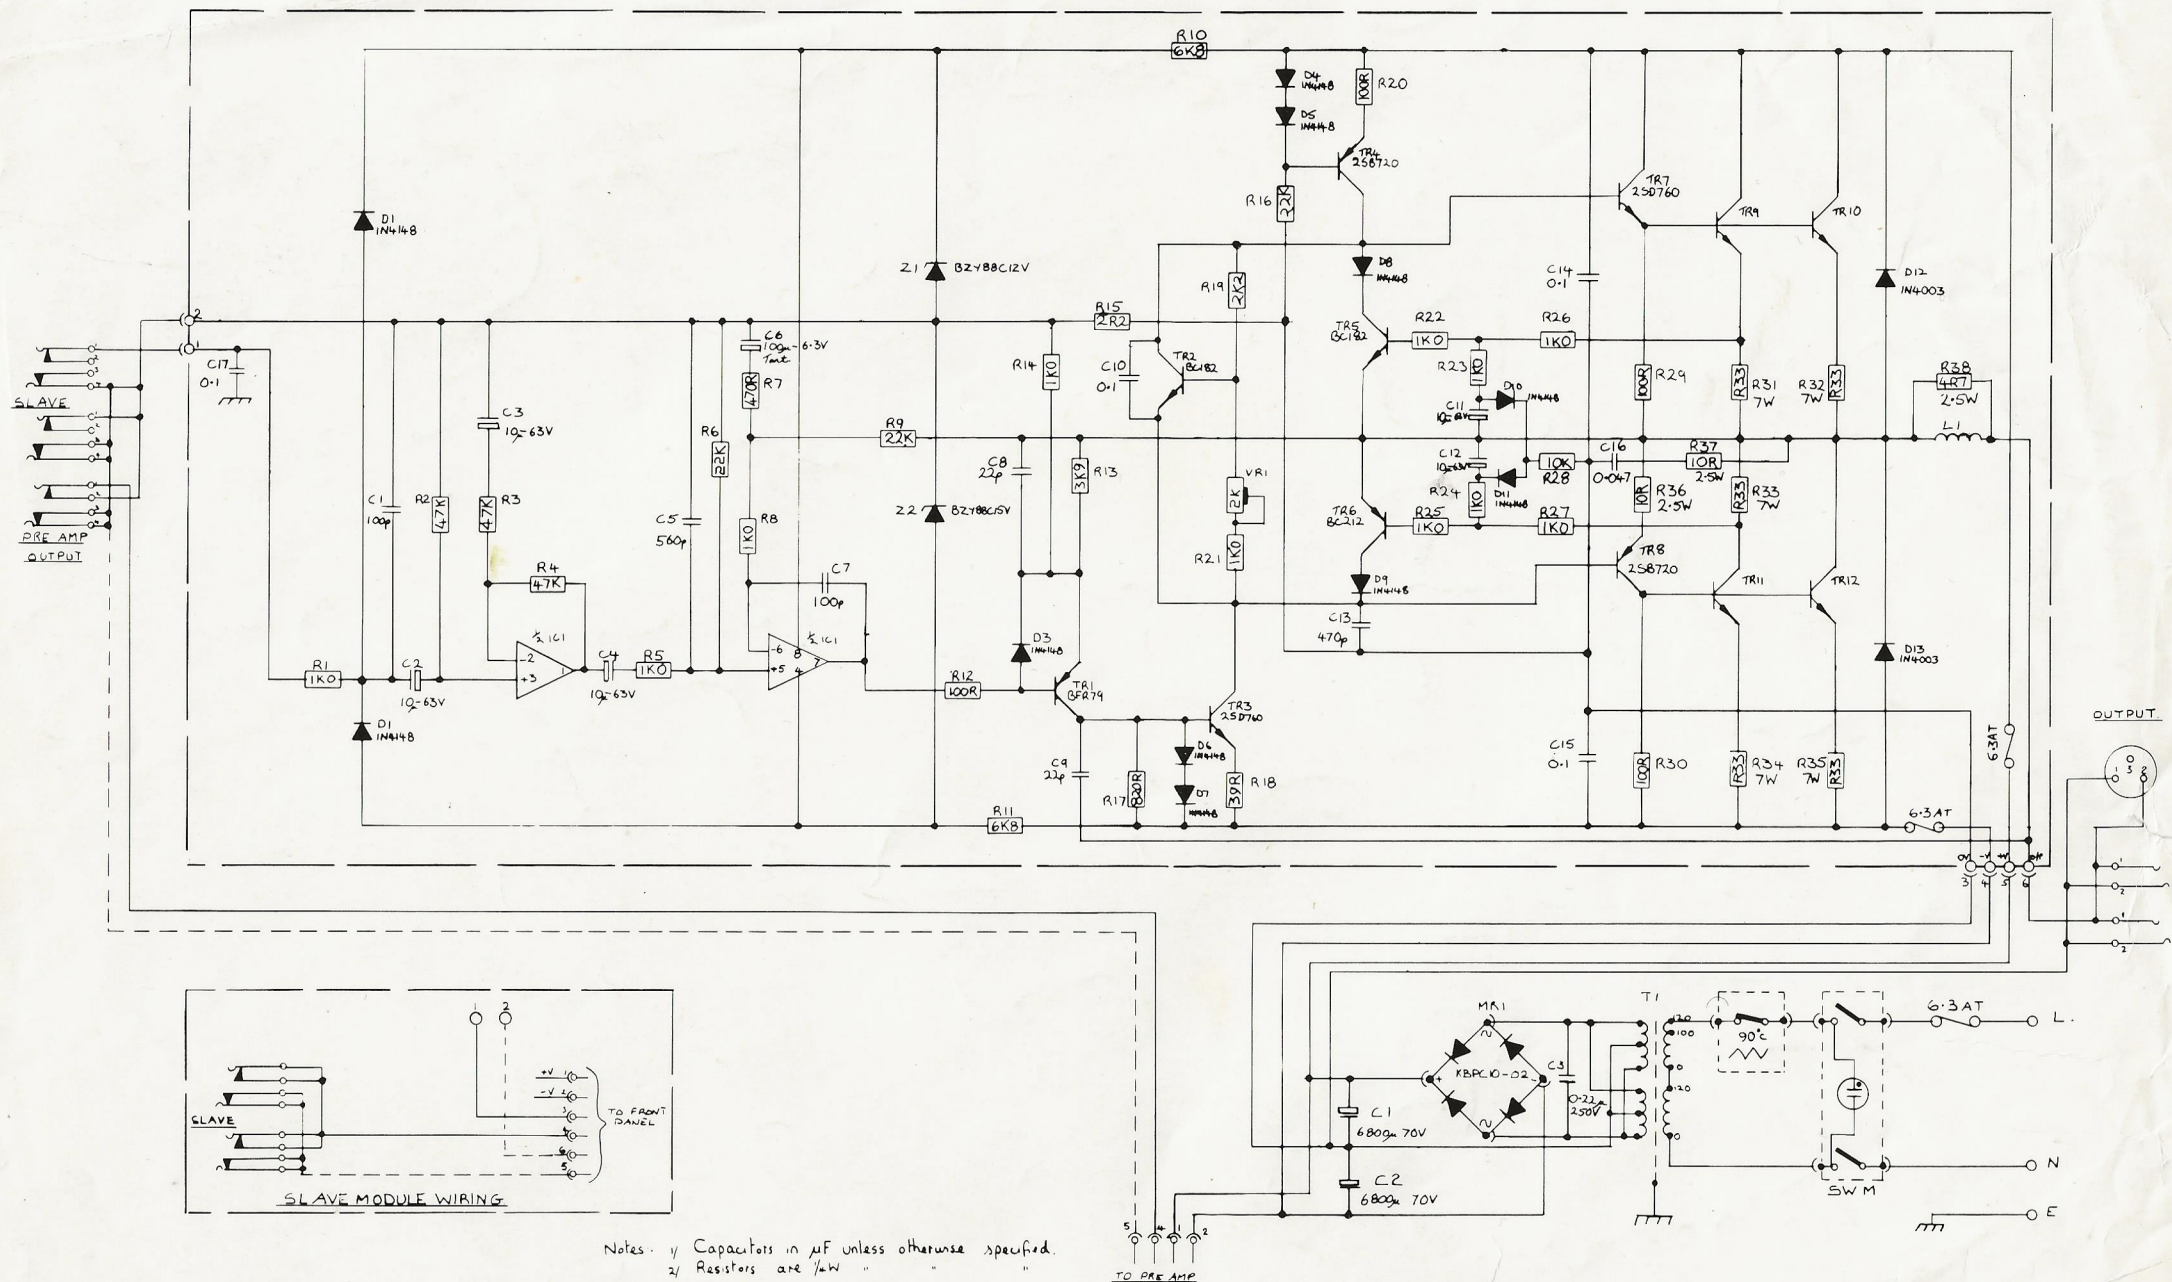

ISSUE 1	CARLSBRO SOUND EQUIPMENT	DRAWN <i>Plant</i> CHECKED FILE P 99	DATE SCALE TOL	MAT'L FINISH	TITLE CIRCUIT DIAGRAM 300W POWER MODULE	DRAWN 10717
---------	--------------------------------	--	----------------------	-----------------	---	----------------